470 Beauty Spot Rd. E
Bennettsville, SC 29512

SUBMITTAL SHEET
QM-HSRX CABLE
HEAT TRACE



CAPACITIES
5, 10, 15, 20 W/ft 120 or 208-277 Volts

JOB NAME: _____

LOCATION: _____

ARCHITECT: _____

ENGINEER: _____

CONTRACTOR: _____

SUBMITTED BY: _____ DATE: _____

TAG/ITEM	QTY.	CATALOG NUMBER	HEATER		MAX CIRCUIT LENGTH	CIRCUIT BREAKER SIZE	MAINTAIN TEMP	MINIMUM AMBIENT TEMP
			W/FT	VOLTS				

ACCESSORIES AND CONTROLS	TAG/ITEM	QTY.	CATALOG NUMBER	DESCRIPTION

SUBMITTED BY:	DATE

APPROVED BY:	DATE

HSRX Self-Regulating Heating Cable

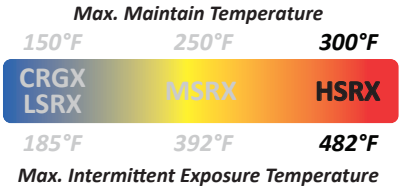

Product Description

The HSRX Self-Regulating Heating Cable is designed for freeze protection and high process temperature maintenance of metal and non-metal pipes, vessels, and equipment where steam cleaning is required.

The unique PTC feature of HSRX self-regulating core elements adjusts its heat output in response to the surrounding temperature along the entire circuit, delivering more heat where and when required. This self-regulating feature also serves to prevent overheating, even in cases where HSRX cables overlap. Another benefit of the cable is the ability to cut to length in the field, completed with Marley Engineered Products system connection kits for quick and convenient installations.

HSRX heating cable system is certified for ordinary and hazardous areas with maximum maintain temperature of 300°F(150°C) and intermittent exposure temperature of 482°F(250°C). Use of Marley Engineered Products connection kits for HSRX installation is required to comply with system approval, ensuring safe operation and reliable thermal performance.

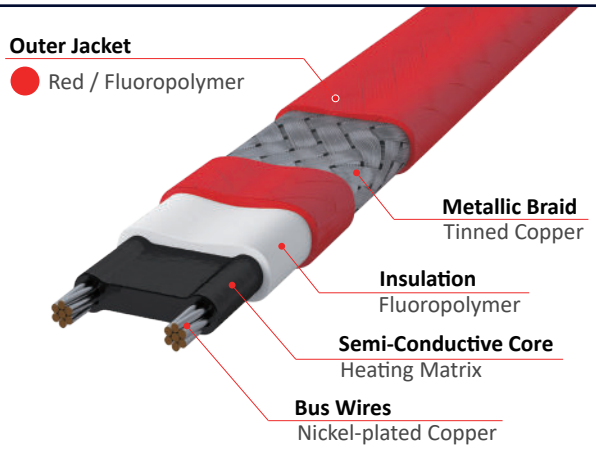

Specification

Max. Intermittent Exposure Temp.	482°F (250°C)
Max. Maintain or Continuous Exposure Temp.	300°F (150°C)
Supply Voltage	120V or 208-277V
Output Wattage	5, 10, 15, 20W/ft @50°F (16, 33, 49, 66W/m @10°C)
Bus wire	16 AWG
Min. Bending Radius	0.8" @70°F (20mm @20°C), 1.8" @-76°F (45mm @-60°C)
Min. Installation Temperature	-76°F (-60°C)
Min. Start-up Temperature	-40°F (-40°C)
Max. Circuit Breaker Size	50A
Outer Jacket Color	Red
Heating Cable Dimensions (Nominal)	0.50" x 0.20" (13.0mm x 5.0mm)
Heating Cable Weight	0.0902lb/ft (0.134kg/m)

Ordering Information

QM-HSRX*a*-*b*CT

QM-HSRX =	Model Name
a =	Output Wattage: 05, 10, 15, 20 W/ft
b =	Voltage: 1 = 120V , 2 = 208-277V
CT =	Outer Jacket: Fluoropolymer

Certification / Approvals

FM26US0013X, FM26CA0003X
Hazardous (classified) locations, indoors and outdoors
Class I, Division 2, Groups A, B, C, and D T3A or T2D (at 20W/ft)
Class II/III, Division 2, Groups F and G T3A or T2D (at 20W/ft)
Class I, Zone 1, AEx/Ex 60079-30-1 IIC T3A or T2D (at 20W/ft) Gb
Zone 21, AEx/Ex 60079-30-1 IIIC T180°C or T215°C (at 20W/ft) Db
Type 4X, IP66

Connection Kits

Marley Engineered Products offers system components for power connections, splice or tee connections and end terminations to ensure proper functioning of the products and comply with warranty and approvals requirements.

For easier installation and safe operation, use of substituted parts are not recommended. Please contact Marley Engineered Products for more information on system components.

©2026 Marley Engineered Products. All rights reserved.

Nominal Power Output Ratings on Insulated Metal Pipes at 120/240

HSRX Power-Temperature Characteristics

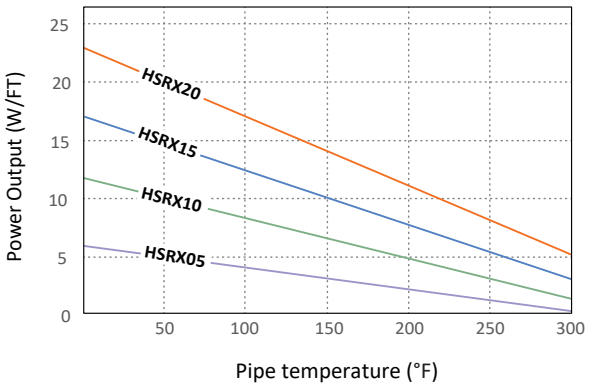

Circuit length adjustment factor

Voltage	HSRX05	HSRX10	HSRX15	HSRX20
208V	0.93	0.94	0.94	0.94
240V	1.00	1.00	1.00	1.00
277V	1.10	1.10	1.11	1.11

Power adjustment factor

Voltage	HSRX05	HSRX10	HSRX15	HSRX20
208V	0.93	0.94	0.94	0.94
240V	1.00	1.00	1.00	1.00
277V	1.10	1.10	1.11	1.11

[Note]
The power output will be derated by 25% on plastic pipes. HTAT-1 aluminum tape is required for installation on plastic pipes.

Max. Circuit Length based on Circuit Breaker Selection

Catalog Number	Start-Up Temperature °F (°C)	Maximum Circuit Length per Circuit Breaker, feet (meters)									
		120V					240V				
		15A	20A	30A	40A	50A	15A	20A	30A	40A	50A
HSRX05	50 (10)	180 (54)	240 (73)	358 (109)	358 (109)	358 (109)	360 (109)	480 (146)	709 (216)	709 (216)	709 (216)
	0 (-18)	141 (42)	187 (57)	281 (85)	358 (109)	358 (109)	281 (85)	375 (114)	562 (171)	709 (216)	709 (216)
	-20 (-29)	129 (39)	172 (52)	258 (78)	345 (105)	358 (109)	258 (78)	345 (105)	517 (157)	689 (210)	709 (216)
	-40 (-40)	120 (36)	159 (48)	239 (72)	319 (97)	358 (109)	239 (72)	319 (97)	478 (145)	638 (194)	709 (216)
HSRX10	50 (10)	107 (32)	142 (43)	213 (65)	253 (77)	253 (77)	213 (65)	284 (86)	427 (130)	502 (153)	502 (153)
	0 (-18)	87 (26)	116 (35)	174 (53)	232 (70)	253 (77)	174 (53)	232 (70)	348 (106)	464 (141)	502 (153)
	-20 (-29)	81 (24)	108 (32)	162 (49)	216 (65)	253 (77)	162 (49)	216 (65)	324 (98)	432 (131)	502 (153)
	-40 (-40)	76 (23)	101 (30)	152 (46)	202 (61)	253 (76)	152 (46)	202 (61)	303 (92)	404 (123)	502 (153)
HSRX15	50 (10)	78 (23)	104 (31)	156 (47)	203 (62)	203 (62)	156 (47)	208 (63)	312 (95)	400 (122)	400 (122)
	0 (-18)	65 (19)	87 (26)	130 (39)	174 (52)	203 (62)	130 (39)	174 (52)	261 (79)	347 (105)	400 (122)
	-20 (-29)	61 (18)	82 (24)	122 (37)	163 (49)	203 (62)	122 (37)	163 (49)	245 (74)	326 (99)	400 (122)
	-40 (-40)	58 (17)	77 (23)	115 (35)	154 (46)	192 (58)	115 (35)	154 (46)	230 (70)	307 (93)	384 (117)
HSRX20	50 (10)	58 (17)	78 (23)	117 (35)	155 (47)	174 (53)	117 (35)	155 (47)	233 (71)	311 (94)	348 (106)
	0 (-18)	50 (15)	67 (20)	100 (30)	134 (40)	167 (50)	100 (30)	134 (40)	200 (61)	267 (81)	334 (101)
	-20 (-29)	47 (14)	63 (19)	95 (28)	126 (38)	158 (48)	95 (28)	126 (38)	190 (57)	253 (77)	316 (96)
	-40 (-40)	45 (13)	60 (18)	90 (27)	120 (36)	150 (45)	90 (27)	120 (36)	180 (54)	240 (73)	300 (91)

[Note]
1. The circuit lengths are based on trip current characteristics of Type QO and Type QCB devices. For devices with different trip characteristics please consult Marley Engineered Products.
2. Use local electrical codes to select appropriate branch circuit breakers.
3. The total length of heating cables connected to the circuit breaker is the sum of all cables that have been spliced or interconnected in parallel. Ensure that the total length does not exceed the maximum circuit length as indicated above.
4. Ground fault protection of equipment is required for heat tracing branch circuits with typical trip level of 30mA. Thermal magnetic breakers are recommended to reduce nuisance tripping.
5. It is recommended to start up the circuits at higher temperatures, when possible, to avoid large start-up or in-rush current which may trip the circuit breaker.

Technical information subject to change without notification.

Questions? Reach out to start a conversation at **MarleyMEP.com**

©2026 Marley Engineered Products. All rights reserved.